


High Level Eductor Vents on the inlet side of the trap should terminate 600mm above the eaves

- 150mm above the intersection with the roof
- not less than 3 metres from air intake. Care is to be taken where arresto in an area where walls ajoin eg. odours are not drawn into the ventilation
- not less than 3 metres above a trafficable roof deck
- not less than 3 metres above a chimney
- not less than 3 metres above a window

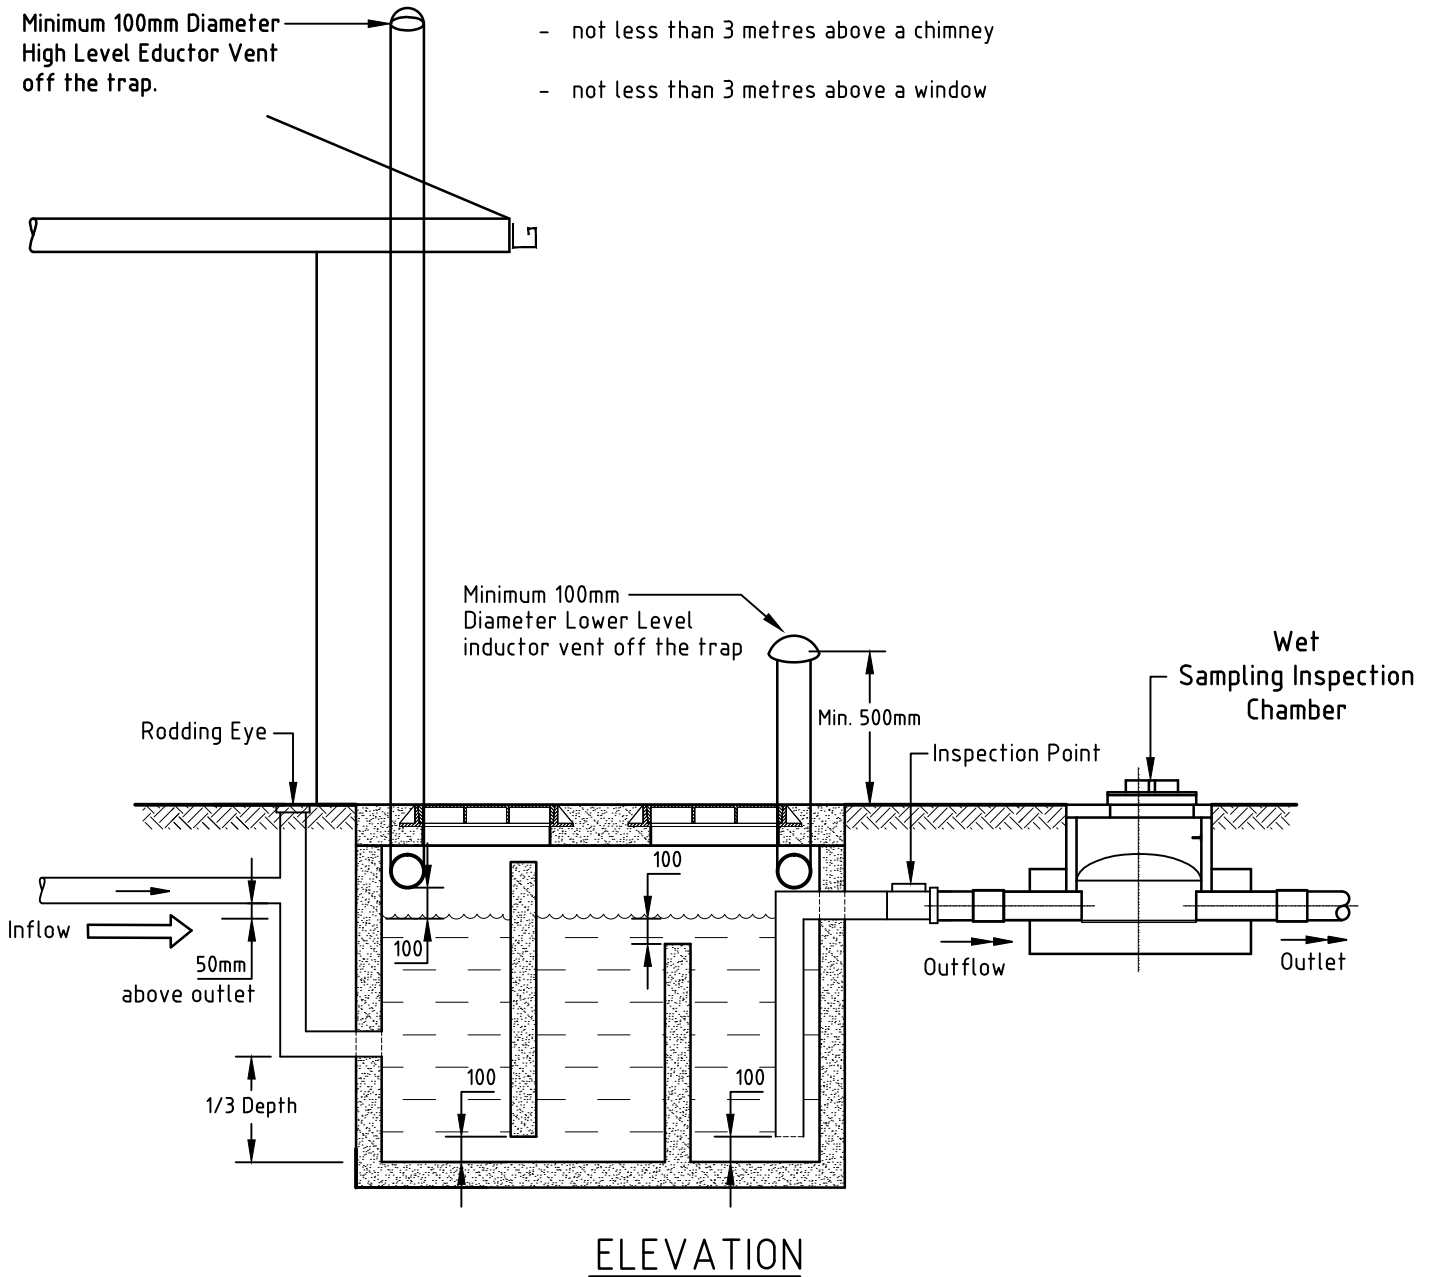

Dimension guidelines for the manufacture of these traps shall be in the proportions of: length is equal to twice the depth and the depth is 1½ x the width.

## STANDARD DRAWING - WASTEWATER SERVICES

THIS DWG REVISED  
JANUARY 2014



### APPROVED PASSIVE TYPE GREASE TRAP AND VENTING

(SIZED TO TRADE WASTE BYLAW SPECIFICATIONS)

10677  
-004

PROPOSED NEW STANDARD

NOT TO SCALE